



KCS-U200 relay - Latching , 2 pole Datasheet



Description

Bistable railway relay with two change-over contacts. The contacts remain in the last powered position. Bistable by means of two coils and a mechanical rocker mechanism. The two separate coils are galvanically isolated. The contacts are weld-no-transfer contacts: they are mechanically forced in the same position.

The KCS-U200 relay is a compact design relay connected with 2.8 x 0.8 mm fastons. The construction of the relay and choice of materials makes the KCS-U200 relay suitable to withstand low and high temperatures, shock & vibrating and dry to humid environments.

Application

These relay series are designed for demanding rolling stock applications. The KCS-U200 is used in applications where two contacts are used in one relay and the contacts are set and reset with permanent power or impulses.

Features

- Latching (bistable) relay
- Compact design
- 2 C/O contacts
- 2 galvanic isolated coils
- Weld-no-transfer contacts
- Flash barrier
- 2.8 x 0.8 faston connections
- Transparent cover

Benefits

- Proven reliable
- Long term availability
- Easy to maintain
- Low life cycle cost
- No maintenance

Railway compliancy

- EN 50155 Electronic equipment used on rolling stock for railway applications
- IEC 60571 Electronic equipment used on railway vehicles
- IEC 60077 Electrical equipment for rolling stock in railway applications
- IEC 60947 Low voltage switch gear and control gear
- IEC 61373 Rolling stock equipment -Shock and vibration test
- IEC 60947-5-4 Electromechanical components for control applications. This standard examines both coil and contact specifications in depth
- EN 50121 Electromagnetic compatibility for railway applications
- NF F 16-101/102, EN 45545-2 Fire behaviour Railway rolling stock
- NF F 62-002 On-off contact relays and fixed connections











Functional and connection diagrams

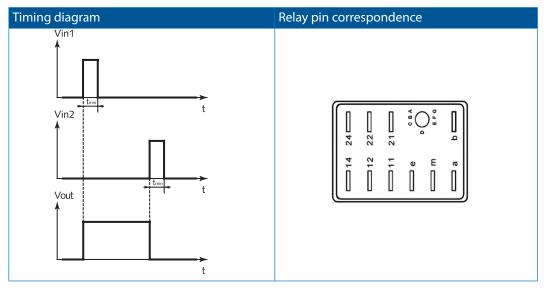

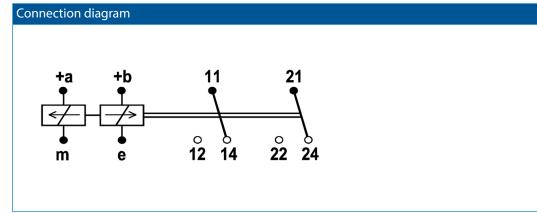







Coil characteristics

| Minimum impulse time | | 25 ms |
|---------------------------|------------------------|--------------|
| Operating voltage range | | 0.71.25 Unom |
| Nominal power consumption | - during interval time | < 1.1 W |
| | - after pulse time | 25 ms |

| Туре | Unom (VDC) | Umin (VDC) | U _{max} (VDC) | Rcoil (Ω)* | Inom (mA) |
|----------|------------|------------|------------------------|------------|-----------|
| KCS-U201 | 24 | 16.8 | 30 | 500 | 48 |
| KCS-U202 | 48 | 33.6 | 60 | 2060 | 23 |
| KCS-U203 | 72 | 50.4 | 90 | 3200 | 15 |
| * | 110 | 77.0 | 137.5 | ** | 12 |
| KCS-U205 | 96 | 67.2 | 120 | 7800 | 12 |
| KCS-U206 | 12 | 8.4 | 15 | 137 | 88 |
| KCS-U207 | 36 | 25.2 | 45 | 1300 | 29 |

Other types on request

* The R_{coil} is measured at room temperature and has a tolerance of \pm 10%

** For 110 VDC: use KCS-U205 in series with external series resistor of 1800 Ω / 0.4 W

Remarks:

- Umin is the must-operate voltage at which the relay has picked up in all circumstances (worst-case situation), in practice the relay picks up at a lower voltage
- Always select the nominal voltage as close as possible to the actual voltage om the application

Contact characteristics

| Amount and type of contacts | 2 C/O |
|-----------------------------|--|
| Maximum make current | 15 A |
| Maximum continuous current | 6 A (AC1 ; IEC 60947) |
| Maximum switching voltage | 300 VDC (then max. current = 300 mA) |
| | 250 VAC (then max. current = 2.6 A) |
| Maximum switching capacity | See graph page 6 |
| Contact resistance | $15 \text{ m}\Omega$ (initial) |
| Material | Ag standard (optional Au on Ag) |
| Contact gap | 0.3 mm |
| Contact force | > 200 mN |

Note : contacts cannot have a different position (forced contacts, weld-no-transfer)





3



Electrical characteristics

| Dielectric strength | EN 50155 | |
|----------------------------------|--------------------|--------------------|
| Pole-pole | IEC 60255-5 | 3 kV, 50 Hz, 1 min |
| Cont-coil | IEC 60077 | 3 kV, 50 Hz, 1 min |
| Insulation between open contacts | 1 kV; 50 Hz; 1 min | |
| Pulse withstanding | IEC 60255-5 | 5 kV (1.2 / 50 μs) |

Mechanical characteristics

| Mechanical life | 30 x 10 ⁶ operations |
|-----------------------------|---------------------------------|
| Maximum switching frequency | Mechanical: 3600 ops/h |
| | Electrical: 1200 ops/h |
| Weight | 75 g |

Environmental characteristics


| Environmental | EN 50125-1 and IEC 60077-1 | |
|-----------------------|--|--|
| Vibration | IEC 61373, Category I, Class B, Body mounted | |
| Shock | IEC 61373, Category I, Class B, Body mounted | |
| Operating temperature | -25 °C+85 °C (optional: -40 °C) | |
| Humidity | 90 % | |
| Salt mist | IEC 60068-2-11, class ST4 | |
| Damp heat | IEC 60068-2-30, Test method Db variant 1 | |
| Protection | IEC 60529, IP40 (relay on socket) | |
| Fire & smoke | NF F 16-101, NF F16-102, TS 45545-2 | |
| Insulation materials | Cover: polycarbonate | |
| | Base: polyester | |







Dimensions (mm)

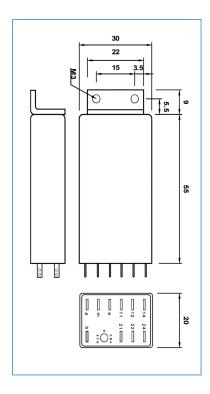





Options

| Code | Description | Remark | Cannot be combined with: | |
|--|--|--|-----------------------------|--|
| В | Magnetic arc blow out | | | |
| С | Low temperature (-40 °C) | | | |
| E * | Au; Gold plated contacts (10 μm) | | | |
| Y | Double make / double break contacts | 1 C/O DM/DB | | |
| Keying | Coil coding relay and socket | | | |
| Colour coding | Coloured cover for coil voltage coding | | | |
| * Gold plated c | contacts characteristics | | | |
| Material | | Ag, 10 μm gold plated | | |
| Maximum switching voltage 60 V (higher voltages may be | | 60 V (higher voltages may be po | possible, contact | |
| | | Mors Smitt for more information) | | |
| Maximum switching current | | 400 mA (at higher rate gold will evaporate, then the | | |
| | | standard silver contact rating of | minimum 10 mA and | |
| | | 12 V is valid) | | |
| Minimum switching voltage | | 5 V | | |
| Minimum switching current | | 1 mA | | |


Also version with PCB mounting available: KCP-U200 relay







Current breaking capacity

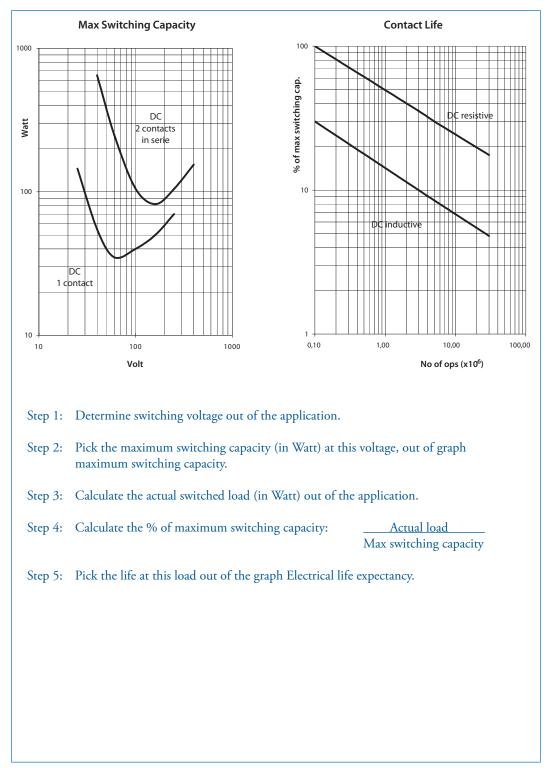







7

KCS-U200 relay Instructions

Installation, operation & inspection

Installation

Before installation or working on the relay: disconnect the power supply first! Connect wiring according to the terminal identification. Check to ensure that the coil connection polarity is not reversed. Relays can be mounted tightly together to save space.

Warning!

- Never use silicon in the proximity of the relays.
- Do not use the relay in the presence of flammable gas as the arc generated from switching could cause ignition.

Operation

After installation always apply the rated voltage to the coil to check correct operation.

Before actual use of relays, it is advised to switch the load several times with the contacts. The contacts will both be electrically and mechanically cleaned due to the positive wiping action. Sometimes a contact can build up increased contact resistance ($\leq 15 \text{ m}\Omega$ when new). When using silver contacts one can clean the contact by switching a contact load a few times using >24 VDC & ~2 A. Increased contact resistance is not always problematic, as it depends on circuit conditions. In general a contact resistance of 1 Ω is no problem, consult Mors Smitt for more information.

Condensation in the relay is possible when the coil is energised (warm) and the outside, environmental temperature is cold. This is a normal phenomenon and will not affect the function of the relay. Materials in the relay have no hygroscopic properties.

Inspection

Correct operation of the relay can easily be checked as the transparent cover provides good visibility of the moving contacts. If the relay does not seem to operate correctly, check for presence of the appropriate coil voltage and polarity using a suitable multimeter.

If the relay doesn't work after inspection, replace the relay unit with a similar model. Do not attempt to open the relay cover or try to repair. Contacts are calibrated and in balance, touching can affect proper operation. Also re soldering may affect correct operation.

Most relay defects are caused by installation faults such as over voltage, spikes/transients, high/short current far exceeding the relay specifications. When returning the relays for investigation, please provide all information on the RMA form. Send defective relays back to the manufacturer for repair or replacement. Normal wear and tear or external causes are excluded from warranty.







KCS-U200 relay Ordering scheme



1. Relay model 2. Coil voltage 3. Options

This example represents a **KCS-U202-E Description**: KCS-U200 series relay, Unom: 48 VDC, gold plated contacts

1. Relay model



2. Coil voltages

| 01 | 24 VDC | |
|----|------------|--|
| 02 | 48 VDC | |
| 03 | 72 VDC | |
| 05 | 96 VDC (*) | |
| 06 | 12 VDC | |
| 07 | 36 VDC | |

* can be used for 110 VDC with an external series resistor of 1800 Ω / 0.4 W

3. Options

B Magnetic arc blow out
C Low temperature (-40 °C)
E Gold plated contacts
Y Double make / double break

Upon ordering indicate keying if necessary.













DS-KCS-U200 V1.4 November 2016



Tour Rosny 2, Avenue du Général de Gaulle, F - 93118 Rosny-sous-Bois Cedex, FRANCE T +33 (0)1 4812 1440, F +33 (0)1 4855 9001 E sales.msf@wabtec.com

Mors Smitt Asia Ltd.

29/F., Fun Towers, 35 Hung To Road Kwun Tong, Kowloon, HONG KONG SAR T +852 2343 5555, F +852 2343 6555 E sales.msa@wabtec.com

Mors Smitt B.V.

Vrieslantlaan 6, 3526 AA Utrecht, NETHERLANDS T +31 (0)30 288 1311, F +31 (0)30 289 8816 E sales.msbv@wabtec.com

Mors Smitt Technologies Inc.

1010 Johnson Drive, Buffalo Grove, IL 60089-6918, USA T +1 847 777 6497, F +1 847 520 2222 E salesmst@wabtec.com

Mors Smitt UK Ltd.

Graycar Business Park, Barton under Needwood, Burton on Trent, Staffordshire, DE13 8EN, UK T +44 (0)1283 722650 F +44 (0)1283 722651 E sales.msuk@wabtec.com

RMS Mors Smitt Ltd.

6 Anzed Court, Mulgrave, VIC 3170, AUSTRALIA T +61 (0)3 8544 1200 F +61 (0)3 8544 1201 E rms@rmspl.com.au



www.morssmitt.com

(c) Copyright 2015

All rights reserved. Nothing from this edition may be multiplied, or made public in any form or manner, either electronically, mechanically, by photocopying, recording, or in any manner, without prior written consent from Mors Smitt. This also applies to accompanying drawings and diagrams. Due to a policy of continuous development Mors Smitt reserves the right to alter the equipment specification and description outlined in this datasheet without prior notice and no part of this publication shall be deemed to be part of any contract for the equipment unless specifically referred to as an inclusion within such contract. Mors Smitt does not warrant that any of the information contained herein is complete, accurate, free from potential errors, or fit for any particular purpose. Mors Smitt does not accept any responsibility arising from any party's use of the information in this document.

