

## Features

- 3A200 RECEIVE relay
- 3A201 SEND relay
- 3A202 combined SEND & RECEIVE relay
- 3A203 2x 3A200 elements per case
- System immunity to AC voltages
- High isolation between coil & contacts & case up to 15KV
- High DC sensitivity
- High visibility mechanical hand reset or self reset flag
- Heavy duty self reset contacts with optional magnetic blowouts to further enhance DC switching capacity
- Made in Australia

## Description


Intertripping over copper pilots using a DC signal is commonly employed. The 3A20 Series Relays are intended for the remote control of switchgear & associated equipment via pilot wires on which induced AC voltages could cause false tripping.

The 3A201 Send relay is used to interface a conventional protection relay to the pilot wire with suitable electrical isolation for the feeder voltage level.

The 3A200 Receive relay is used to interface the pilot wire to the circuit breaker at the receive end with suitable electrical isolation for the feeder voltage level. The 3A200 employs an internal filter & a special relay coil fitted with a copper sleeve over the core which makes the relay element immune to AC voltages. The high DC sensitivity of the relay allows operation over pilot wires at nominal voltage with loop resistances of up to 2,700 ohms.

The 3A202 relay combines a 3A201 Send & a 3A200 Receive relay element in a single case for two way intertripping applications.

The 3A203 relay combines 2x 3A200 Receive relay elements in a single case to reduce panel space requirements.

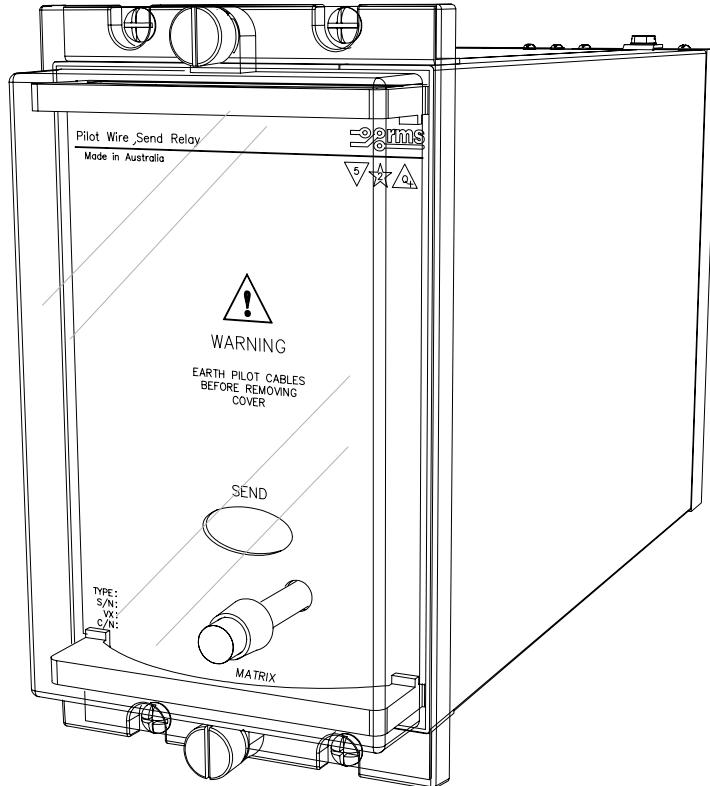

3A201 15KV version depicted in a size 4M case

## Operation

Made in Australia

The operating element of the 3A20 Series is based on the well proven 6R heavy duty attracted armature control relay. The DC version of this relay is inherently immune to AC voltages & the addition of an AC filter circuit & copper shield over the core of the receive relay greatly enhances this attribute while maintaining high sensitivity to DC voltages.

A mechanical flag indicator is provided on both the send & receive elements which drops on pick up. Manual & self reset version available.

The 3A201 send element is used to apply a DC control voltage to the pilot wire which will be detected by the 3A200 receive element & the auxiliary contacts picked up.

The 3A202 version combines a 3A201 send & a 3A200 receive element in a single case (2KV & 5KV versions only).

The 3A203 version combines 2x 3A200 receive elements in a single case (2KV & 5KV versions only).

## HIGH VOLTAGE ISOLATION

Pilot wire relays require high levels of isolation between coil & contacts as the pilots may be subject to insulation break down & high induced voltages caused due to proximity to the high voltage cables.

The 3A20 relays are available in three models depending on the isolation requirements of the particular application:

For system voltages up to 6.6KV a 2KV RMS insulation level is normally considered adequate;

For system voltages up to 22KV a 5KV RMS insulation level is normally considered adequate;

For system voltages above 22KV a 15KV RMS insulation level should be considered.

## INSULATION RATING

2KV / 5KV / 15KV RMS between input & frame, outputs & frame, outputs & inputs.

1.2/50 5KV impulse between each terminal & earth, between circuits not normally connected together & between terminals of the same circuit.


A clear polycarbonate terminal covers are supplied for 15KV isolated relay versions.

## ORDERING CODE, CASE TYPE & WIRING SCHEDULE


Ordering Code	Isolation Level	Case type	Wiring Schedule	Maximum Contacts M or B
3A200-x-x-A-A-x-x	2KV	2M28-S	A	4
3A200-x-x-B-A-x-x	5KV	2M28-S	A	4
3A200-x-x-C-A-x-x	15KV	4M10	B	4
3A200-x-x-C-B-x-x	15KV	Y	C	3
3A201-x-x-A-A-x-x	2KV	2M28-S	D	4
3A201-x-x-B-A-x-x	5KV	2M28-S	D	4
3A201-x-x-C-A-x-x	15KV	4M10	B	4
3A201-x-x-C-B-x-x	15KV	Y	C	3
3A202-x-x-A-A-x-x	2KV	2M28-S	E	4
3A202-x-x-B-A-x-x	5KV	4M28-S	E	4
3A203-x-x-A-A-x-x	2KV	2M28-S	E	4
3A203-x-x-B-A-x-x	5KV	4M28-S	E	4

Table 1

"x" indicates that all options are possible for this ordering code.

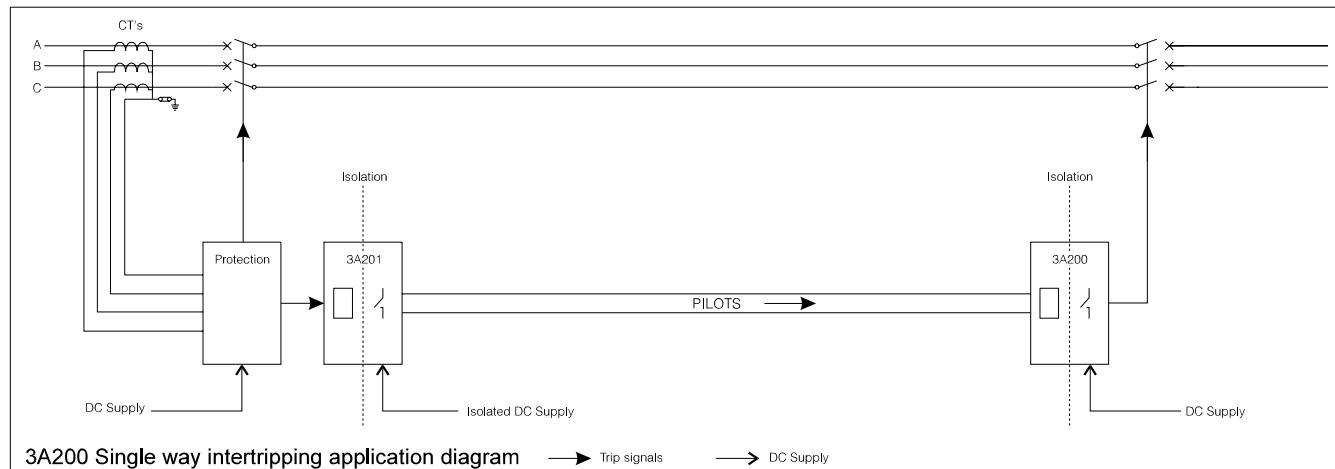

3A200 Single way intertripping application diagram      → Trip signals      → DC Supply

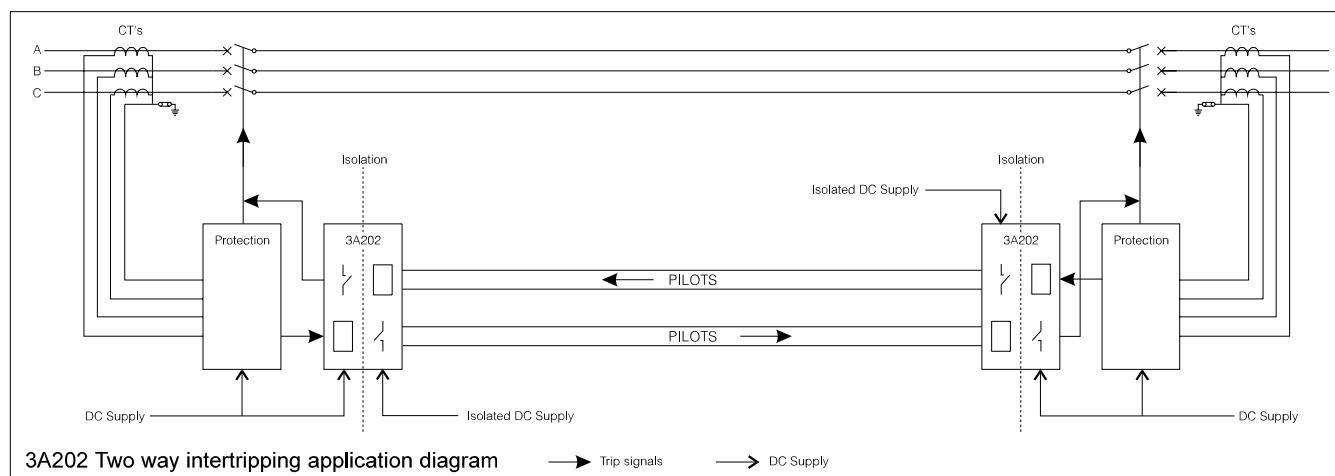

3A202 Two way intertripping application diagram      → Trip signals      → DC Supply




CERTIFIED QUALITY  
MANAGEMENT SYSTEM  
ISO 9001

Visit [WWW.rmsp.com.au](http://WWW.rmsp.com.au) for the latest product information.

Due to RMS continuous product improvement policy this information is subject to change without notice. 3A20/Issue N/17/08/10 - 2/5

# Wiring Schedules

## TERMINAL LAYOUT FOR 2M28 & 4M28 CASES

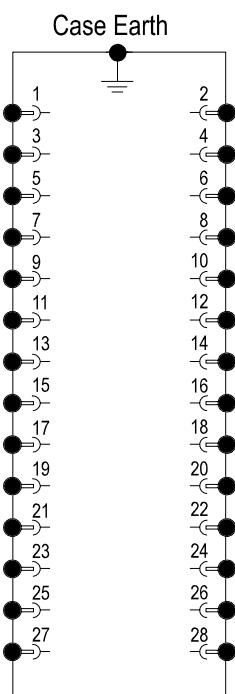


3A200	Wiring Schedule		
	A	B	C
RECEIVE Coil	+27, -28	+9, -10	+1, -2
Contact 1-1	17, 19	1, 3	3, 4
Contact 1-2	18, 20	2, 4	5, 6
Contact 1-3	21, 23	5, 7	7, 8
Contact 1-4	22, 24	6, 8	


3A201	Wiring Schedule		
	D	B	C
SEND Coil	+11, -12	+9, -10	+1, -2
Contact 1-1	1, 3	1, 3	3, 4
Contact 1-2	2, 4	2, 4	5, 6
Contact 1-3	5, 7	5, 7	7, 8
Contact 1-4	6, 8	6, 8	

3A202 / 203	Wiring Schedule	
	E	
SEND Coil	+11, -12	
Contact 2-1	1, 3	
Contact 2-2	2, 4	
Contact 2-3	5, 7	
Contact 2-4	6, 8	
RECEIVE Coil	+27, -28	
Contact 1-1	17, 19	
Contact 1-2	18, 20	
Contact 1-3	21, 23	
Contact 1-4	22, 24	


## 2M28-S CASE DRAWING

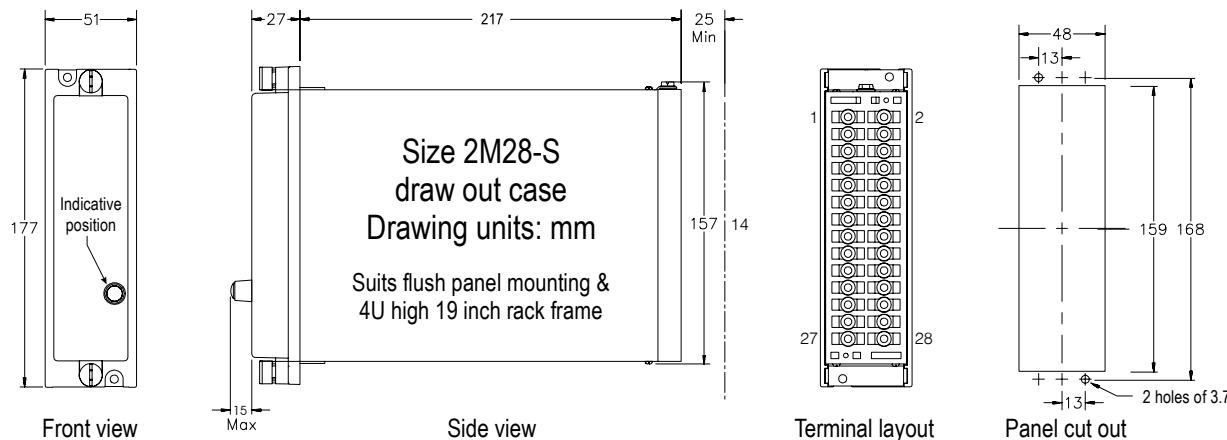


## 4M28-S CASE DRAWING

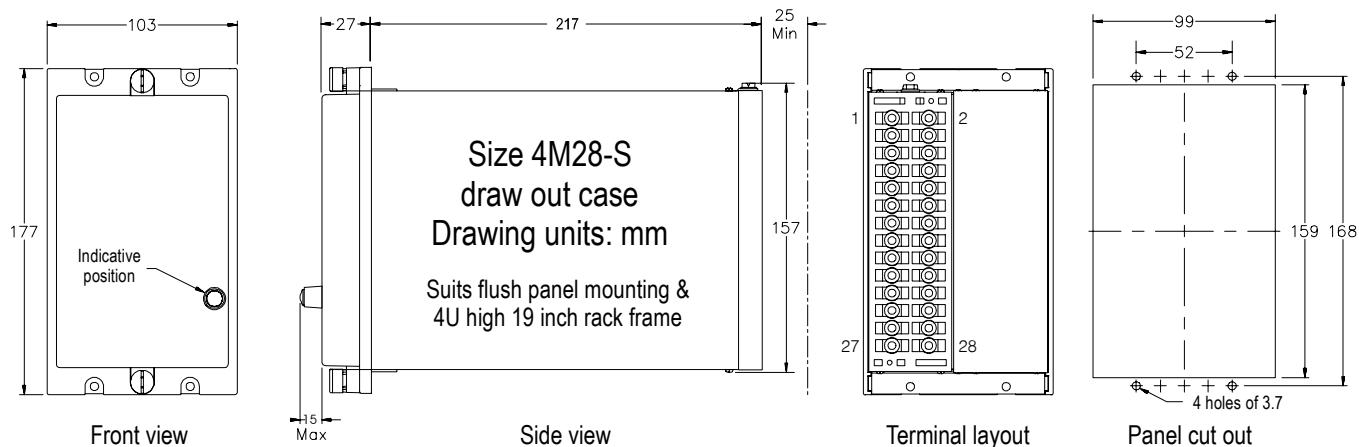

## 4M10 CASE DRAWING

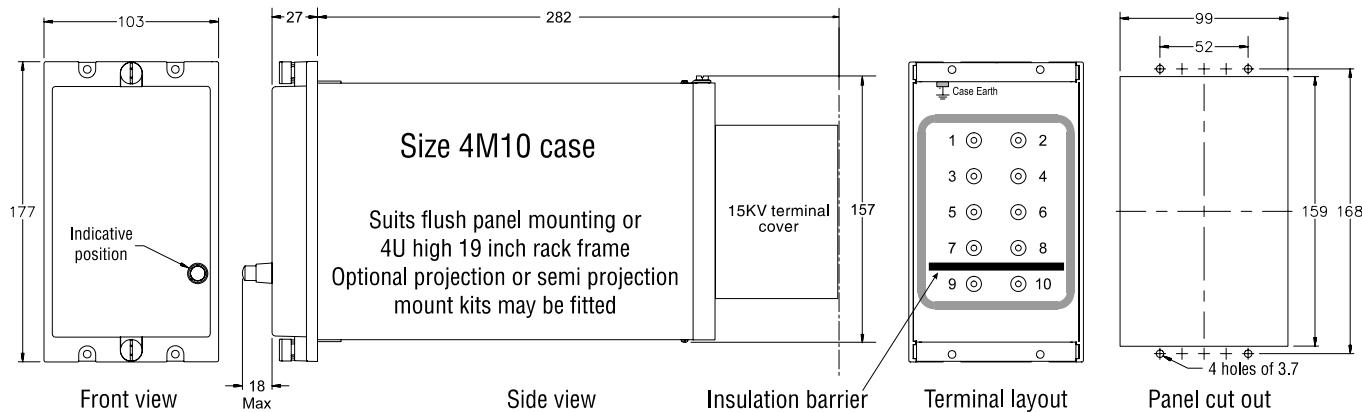

## Y SERIES CASE DRAWING

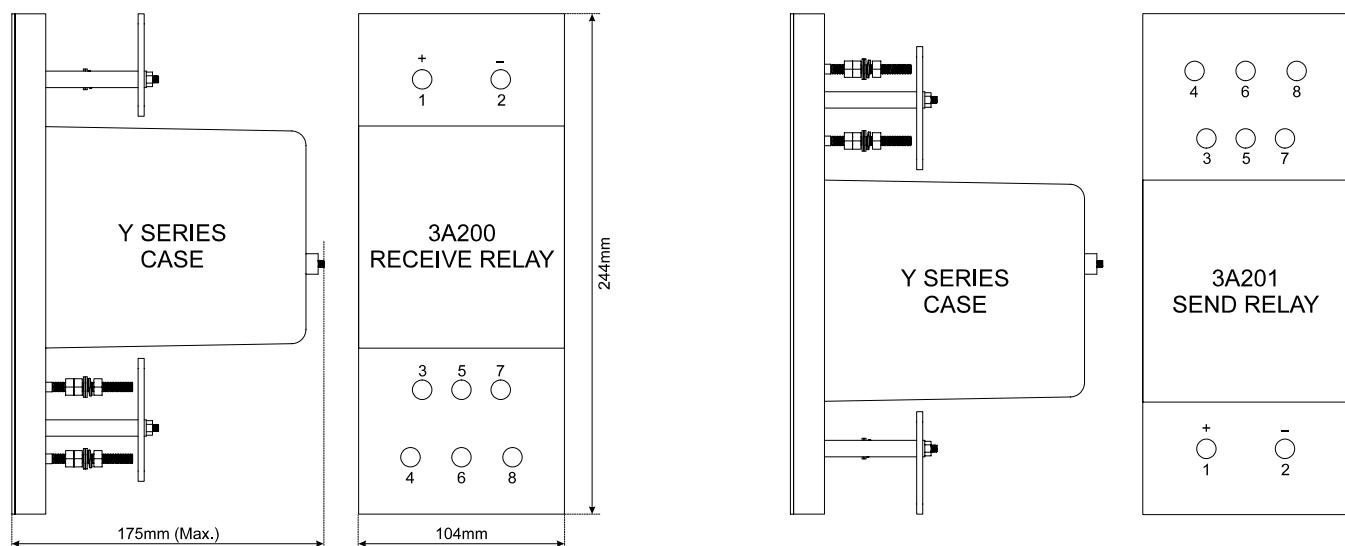

## Technical Data

### TRIP SUPPLY BURDEN

- 3A200 <2.5W per coil & resistor circuit  
 3A201 <7W at nominal  
 3A202 As per 3A200 & 3A201  
 3A203 As per 3A200

### FLAG INDICATION

High visibility electromechanical flag indicator drops when a fault is detected (Coil energisation). A hand reset version is available with a front panel mounted hand reset push button. Alternatively a self reset version is available.

### OPERATE TIME (Zero pilot loop resistance)

- 3A200 ~50ms on application of nominal DC  
 3A201 ~30ms on application of nominal DC  
 3A202 As per 3A200 & 3A201  
 3A203 As per 3A200

### AC IMMUNITY – 3A200

The 3A200 element is immune to induced AC voltages -  
 48V DC version: 140V 50Hz immunity  
 110V & 125V DC versions: 300V 50Hz immunity

### INSULATION WITHSTAND

In accordance with IEC 255-5:

2KV / 5KV / 15KV RMS between input & frame, outputs & frame, outputs & inputs. 1.2/50 5KV impulse between each terminal & earth, between circuits not normally connected together & between terminals of the same circuit.

### NOISE IMMUNITY

Withstands the high frequency interference test detailed in IEC 255-22-1.

### OUTPUT CONTACTS

Maximum M or B: Refer Table 1.  
 Optional: With magnetic blowouts fitted

### TERMINAL COVERS

4M flush mount case: Clear polycarbonate cover supplied for 15KV model in 4M flush mount case.  
 Y surface mount case: 2 x polycarbonate terminal covers provided.

### 6R RELAY CONTACT RATINGS

#### Make & Carry Continuously

3,000 VA AC resistive with maximums of 660V & 12A  
 3,000 VA DC resistive with maximums of 660V & 12A

#### Make & Carry for 0.5 Seconds

7,500 VA AC resistive with maximums of 660V & 30A  
 7,500 VA DC resistive with maximums of 660V & 30A

#### AC Break Capacity

3,000 VA AC resistive with maximums of 660V & 12A

#### DC Break Capacity (Amps)

Voltage		24V	48V	125V	250V
Resistive rating		a b	12 12	1.5 12	0.5 10
L/R=40ms	Maximum break *	a b	12 30	1 15	0.2 5.5
	1K operations (N3 Rating)	b	12	12	5
					2.5

a = Without magnetic blowouts b = With magnetic blowouts

All data relates to both the 3A200 & 3A201 unless otherwise stated.  
 The 3A202 is a combined 3A200 & 3A201 mounted in a single case.

## 3A20 Ordering Codes

Generate the required ordering code with reference to Table 1:

e.g. 3A200-DBBAA-2M2B



### 1 RELAY FUNCTION

- 0 RECEIVE relay  
 1 SEND relay  
 2 Combined SEND & RECEIVE relay (2KV & 5KV isolation only)  
 3 2x 3A200 RECEIVE relay elements per case

### 2 NOMINAL OPERATE VOLTAGE (75 to 120% of nominal)

- C 48V DC  
 D 110V DC  
 E 125V DC

### 3 CONTACT DUTY

- A Magnetic blowouts fitted  
 B Heavy duty contacts

### 4 HIGH VOLTAGE INSULATION WITHSTAND

- A 2KV RMS  
 B 5KV RMS  
 C 15KV RMS

### 5 CASE TYPE

- A M Series case – Flush or projection mount rear connect  
 B Y Series case - Surface mount front connect (15KV only)

### 6 FLAG OPERATION

- A Hand reset flag (Default)  
 B Self reset flag  
 C Flag not required

### 7 CONTACT ARRANGEMENT

Specify the number of "MAKES" followed by M; i.e. 2M  
 Specify the number of "BREAKS" followed by B; i.e. 2B



CERTIFIED QUALITY  
MANAGEMENT SYSTEM  
ISO 9001

Visit [WWW.rmsp.com.au](http://WWW.rmsp.com.au) for the latest product information.

Due to RMS continuous product improvement policy this information is subject to change without notice. 3A20/Issue N/17/08/10 - 5/5

## Australian Content

Unless otherwise stated the product(s) quoted are manufactured by RMS at our production facility in Melbourne Australia. Approximately 60% of our sales volume is derived from equipment manufactured in house with a local content close to 80%. Imported components such as semi-conductors are sourced from local suppliers & preference is given for reasonable stock holding to support our build requirements.

## Quality Assurance

RMS holds NCSI (NATA Certification Services International), registration number 6869 for the certification of a quality assurance system to AS/NZS ISO9001-2008. Quality plans for all products involve 100% inspection and testing carried out before despatch. Further details on specific test plans, quality policy & procedures may be found in section A4 of the RMS product catalogue.

## Product Packaging

Protection relays are supplied in secure individual packing cardboard boxes with moulded styrene inserts suitable for recycling. Each product & packing box is labeled with the product part number, customer name & order details.

## Design References

The products & components produced by RMS are based on many years of field experience since Relays Pty Ltd was formed in 1955. A large population of equipment is in service throughout Australia, New Zealand, South Africa & South East Asia attesting to this fact. Specific product & customer reference sites may be provided on application.

## Product Warranty

All utility grade protection & auxiliary relay products, unless otherwise stated, are warranted for a period of 24 months from shipment for materials & labour on a return to factory basis. Repair of products damaged through poor application or circumstances outside the product ratings will be carried out at the customer's expense.

## Standard Conditions of Sale

Unless otherwise agreed RMS Standard Terms & Conditions (QF 907) shall apply to all sales. These are available on request or from our web site.



# Relay Monitoring Systems Pty Ltd

6 Anzed Court, Mulgrave, Victoria 3170, AUSTRALIA

Tel: +61 3 8544 1200 Fax: +61 3 8544 1201 Email: [rms@rmspl.com.au](mailto:rms@rmspl.com.au) Web: [www.rmspl.com.au](http://www.rmspl.com.au)